


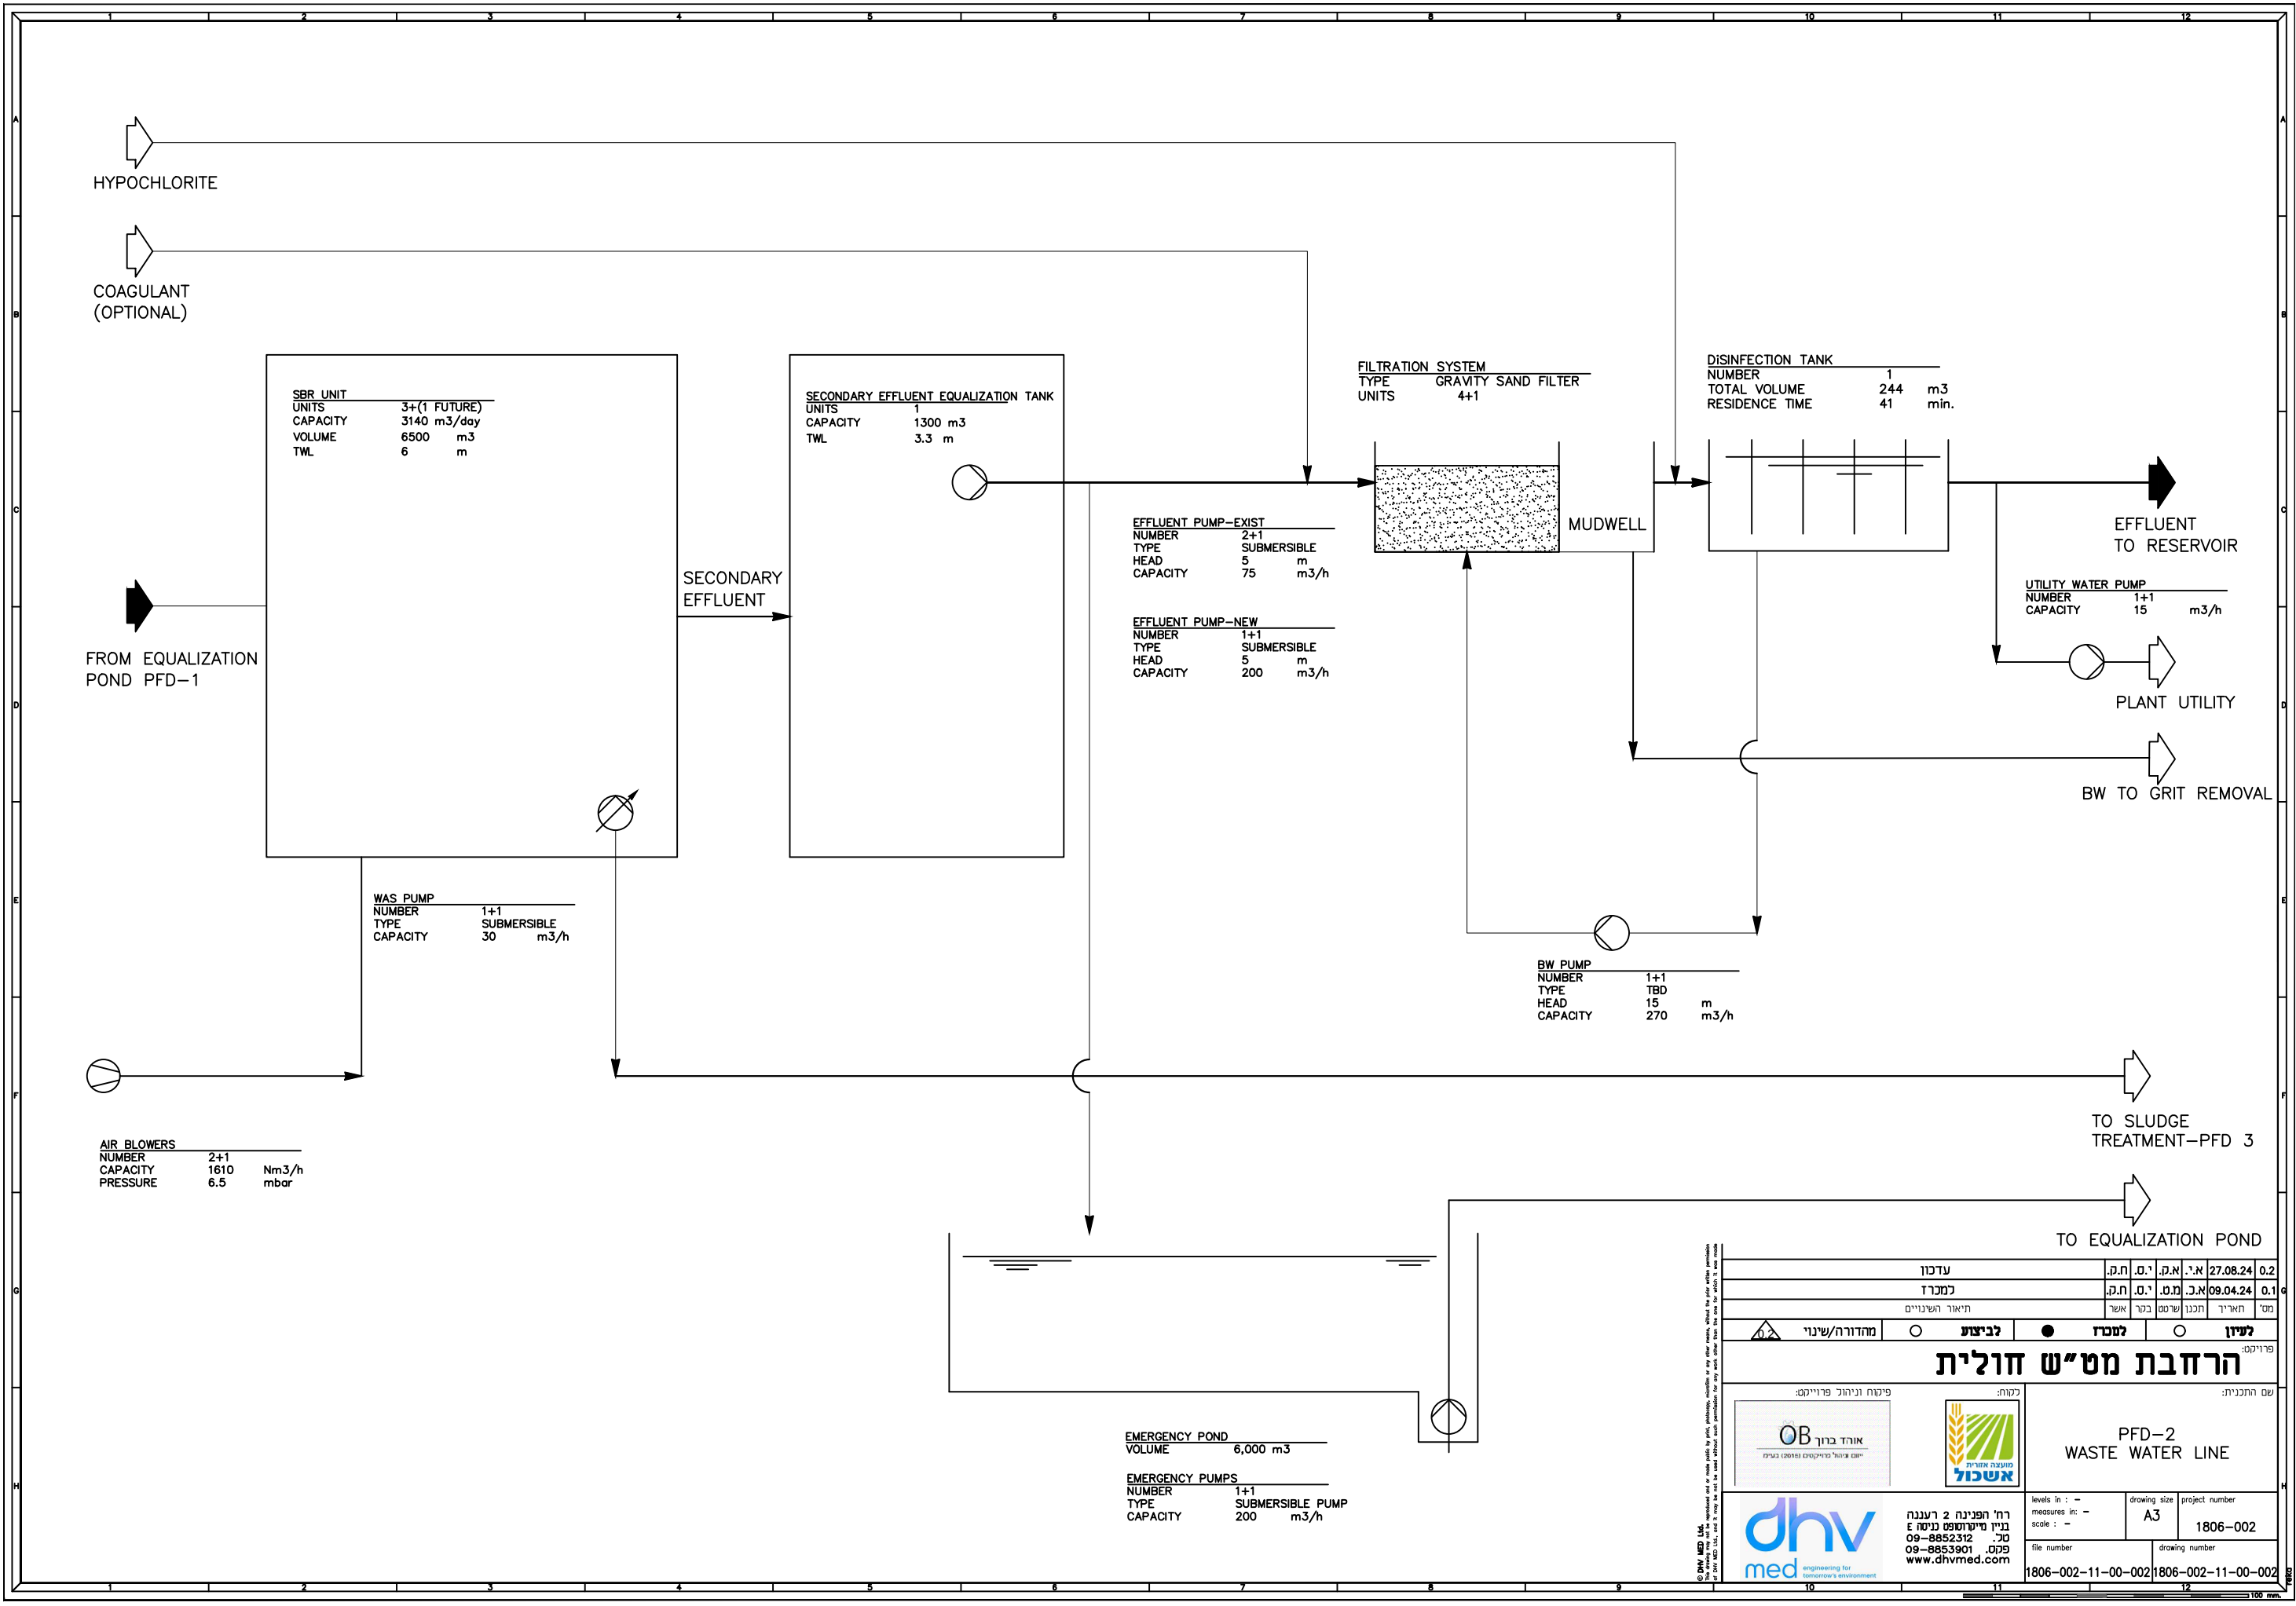

HYPOCHLORITE

COAGULANT
(OPTIONAL)

SBR UNIT	
UNITS	3+(1 FUTURE)
CAPACITY	3140 m ³ /day
VOLUME	6500 m ³
TWL	6 m

SECONDARY EFFLUENT EQUALIZATION TANK	
UNITS	1
CAPACITY	1300 m ³
TWL	3.3 m

FILTRATION SYSTEM	
TYPE	GRAVITY SAND FILTER
UNITS	4+1

DISINFECTION TANK	
NUMBER	1
TOTAL VOLUME	244 m ³
RESIDENCE TIME	41 min.

EFFLUENT PUMP-EXIST	
NUMBER	2+1
TYPE	SUBMERSIBLE
HEAD	5 m
CAPACITY	75 m ³ /h

EFFLUENT PUMP-NEW	
NUMBER	1+1
TYPE	SUBMERSIBLE
HEAD	5 m
CAPACITY	200 m ³ /h

WAS PUMP	
NUMBER	1+1
TYPE	SUBMERSIBLE
CAPACITY	30 m ³ /h

BW PUMP	
NUMBER	1+1
TYPE	TBD
HEAD	15 m
CAPACITY	270 m ³ /h

UTILITY WATER PUMP	
NUMBER	1+1
CAPACITY	15 m ³ /h

AIR BLOWERS	
NUMBER	2+1
CAPACITY	1610 Nm ³ /h
PRESSURE	6.5 mbar

EMERGENCY POND	
VOLUME	6,000 m ³

EMERGENCY PUMPS	
NUMBER	1+1
TYPE	SUBMERSIBLE PUMP
CAPACITY	200 m ³ /h

עדכון

למכרז

תיאור השכנויים

ח.ק.

י.ס.

א.ק.

י.א.

27.08.24

0.2

ח.ק.

י.ס.

א.ק.

י.א.

09.04.24

0.1

ח.ק.

י.ס.

א.ק.

י.א.

09.04.24

0.1

לעיון

למכרז

לביצוע

מחזור/שינוי

פרויקט:

הרחבת מט"ש חולית

שם התכנית:

פיקוח וניהול פרוייקט:

אורח בן

ימים אהבה

ימים אהבה

אשכול

מנהל אזורי

dhv med

engineering for tomorrow's environment

ר"ח הפניה 2 רעננה

ניין וינדוסטרי ניהול

טל: 09-8852312

פקס: 09-8853901

www.dhvmed.com

levels in : -

measures in: -

scale : -

A3

project number

1806-002

file number

1806-002-11-00-002

1806-002-11-00-002